

Prospect of PV-wind-diesel hybrid system as an alternative power supply for Miangas Island in Indonesia

by Meita Rumbayan 3

Submission date: 10-May-2023 10:02AM (UTC+0700)

Submission ID: 2089127208

File name: Prospect_of_PV-Wind_Diesel_in_Miangas_Island-compressed-1.pdf (137.36K)

Word count: 3120

Character count: 16504

Prospect of PV-wind-diesel hybrid system as an alternative power supply for Miangas Island in Indonesia

Meita Rumbayan^a, Yosuke Nakanishi^{b*}

^a Sam Ratulangi University, Engineering Faculty, Manado, Indonesia

^b Waseda University, Power System and Environment Lab, Tokyo, Japan

26

Abstract

35

The purpose of this paper is to conduct a feasibility study of hybrid power system based on renewable energy resources for Miangas island, which is located on the border between Indonesia and the Philippines. It is the outermost island that situated in the North part of Sulawesi mainland which became the front porch of Indonesian territory. The prospect of wind-diesel-battery hybrid system as an alternative power supply for Miangas island has been analyzed using HOMER (Hybrid Optimization Model for Electric Renewable). The predicted monthly average daily radiation in Miangas island is 5.52 kWh/m². The wind speed varies seasonally from 3.1 m/s to 5.3 m/s. The hybrid system analysis has showed that the electricity is generated in a year is 240,068 kWh in which electricity energy sharing consist of PV, wind, diesel are 77%, 0.5% and 22.5% respectively. In addition, the simulation results for the proposed hybrid system in Miangas island community find the value of cost of energy (COE) as 0.3178 USD/kWh, Net Present Cost (NPC) as 986,356 USD and operating cost as 52,887 USD.

Keywords: Renewable energy, hybrid system, island communities, remote island, Indonesia

1. Introduction

For the sake of island communities in the border area of Indonesia, it is necessary to pay special attention so that the energy needs of remote areas and island communities are met on a sustainable basis. Dependence on the supply of fossil fuels from the island to the island that have high transportation costs and produce greenhouse gases need to be minimized. For this reason the utilization of renewable energy as an alternative energy source for energy generation needs to be studied. Additionally, the need to provide the islands for energy security become important issue for energy policy of the nation.

Miangas island was chosen as the location to be studied because of its specificity located on the border between Indonesia and the Philippines is the outermost island which became the front porch of Indonesian territory. Miangas island is situated in regency of Talaud Island, North Province of Indonesia. It is located at latitudes 05° 33' 20.8" North and longitudes 127° 09' 6.8" East. It takes 3 hours by boat from Malonguane (the nearest city as the capital of Talaud region). The total land area is approximately 3.2 km². According to the data from Statistics Centre of Indonesia, the communities of Miangas island consists of 845 people in 2015.

Miangas island is facing the high cost of diesel fuel due to remoteness from Sulawesi mainland. This article presents a feasibility study of wind-Diesel-Battery hybrid system for a remote island in Indonesia, the case study of Miangas island in order to reduce the dependency to the high cost of stand alone diesel system. A previous study [1] found that the potential of renewable energy resources for Indonesia's island should be considered to be interest as an alternative power supply for island communities need. A result of the mapping of solar energy potential in Indonesia, the Northern part of

* Manuscript received September 30, 2018; revised May 2, 2019.

Corresponding author. E-mail address: meitarumbayan@unsrat.ac.id

doi: 10.12720/sgce.8.4.402-407

Sulawesi island can be one of the most suitable region for generating electricity from solar energy.

The organization of this article is as follows. Section 2 presents a brief literature reviews of previous work of analyzing the hybrid system using HOMER in many locations. Section 3 describes the methods that use in this study consists of load profile data, resources data and component input for system analysis. Section 4 provides the simulation results of the HOMER for the case study of Miangas island. Section 5 gives the conclusions.

2. Literature Review

This section presents literature review about the analysis works for power system infrastructure model for island communities by utilizing HOMER (Hybrid Optimization of Multiple Energy Resources) software from National Renewable Energy Laboratory (NREL).

HOMER software has been used to perform the techno economic feasibility of possible models in developing the power system infrastructures. HOMER is an optimization software package, which can handle different technologies (including PV, wind, hydro, fuel cells) and evaluate design options for both off-grid and grid-connected power systems for remote, stand alone and distributed generations applications [2].

There are many studies has been conducted to study of HOMER utilization for analysing the model of power system generation. Dursun et al [3] studied a micro-grid wind-PV hybrid system for a remote community with 50 houses in order to find the optimal configuration and present a techno-economic analysis for the considered power generating system by the HOMER software. Bekele and [4] presented a feasibility study for a stand-alone solar-wind based hybrid energy system for a model community of 16 families using HOMER software. Lipu et al [5] conducted a feasibility study of solar-wind- hybrid in rural and remote areas of Bangladesh. Al-Badi [6] evaluated the techno-economic feasibility of a hybrid wind-PV-diesel power system to satisfy the load of Al Hallaniyat Island.

Many studies have been reported analysing renewable energy based on power generation using HOMER. Himri et al. [7] study of hybrid power system for a remote village in Algeria, while Nandi and [8] present a study of a Bangladesh village and Nfah et al [9] report case study of Ethiopia. Although several studies are conducted for hybrid renewable energy system, no research is reported for the case of Miangas island in Indonesia.

The location of the community is important to know as electricity demand patterns differ with geographical site and cultural habits [10]. HOMER uses the optimizer proprietary algorithm to search for the lowest net present cost system for the specific load and condition [11]. Homer's software capability for modeling has been demonstrated, through two experiments on small-scale systems by comparing HOMER modeling results with direct measurement results [12].

Hybrid renewable energy system that combined the types of renewable energies sources can be a more reliable approach for meeting the electric energy demand in remote areas. By combining a diesel generator with photovoltaic and/or wind system can decrease diesel fuel consumption and minimize the operating cost of the system [13]. The balanced system can provide stable outputs from sources and minimizes the dependence of the output upon seasonal changes, furthermore it optimizes utilization of the different renewable sources of energy available [14].

Renewable sources for generating electricity in the hybrid system are photovoltaic (PV), wind turbines, generators, battery and converter. Photovoltaic (PV) panels convert solar radiation into direct current (DC) power, while wind turbines convert wind energy to AC/DC power. Generators are dispatchable energy sources which can compensate for renewable sources in system. The other components in hybrid systems are batteries which are used in order to increase the reliability of the system. Whenever the renewable sources can supply the demands, the excess energy can be stored in the batteries. Subsequently whenever renewable sources are not available, the batteries feed electricity into the system. Another components used in hybrid systems is a converter, which is change the DC power to AC power [15].

3. Methods

The method to conduct the technical-economic study of hybrid power generation for communities in the remote island of Indonesia is using HOMER software. This software developed by the National Renewable Energy Laboratory (<http://www.homerenergy.com>) a division of the US Department of Energy used to design a hybrid power plant system using renewable energy.

The data collected for the input, in the form of population data and the daily load average condition of electricity in Miangas island are given in Table 1.

Table 1. The data collected in Miangas Island

Item	Value
Number of People	881
Number of Households	324
Daily Load Average (kWh)	657

Feasibility of solar energy system mainly depends on solar radiation available at the specific location. Data of solar energy sources in term of solar radiation in Miangas island have been taken from NASA (National Aeronautics and Space Administration) website by input the latitude and longitude of the location. The average annual solar radiation equals to 5.53 kWh/m²/day. HOMER also gives the clearness index data and wind speed for Miangas island. Clearness index is the amount of global solar radiation on the surface of the earth divided by the extra-terrestrial radiation at the top of the atmosphere [16]. Solar energy potential in Indonesia has been studied and mapped by Rumbayan et al [17]. The maps can provide useful information for national as well as regional and local renewable energy planning in the islands of Indonesia. They are the first maps to be published in the literature and will benefit decision makers and engineers to develop solar energy systems.

The data of solar radiation, clearness index and wind speed in Miangas island are presented in Table 2.

Table 2. Average Monthly Solar Radiation in Miangas Island

Month	Solar Radiation (KWh/m ² /day)	Clearness Index	Wind Speed (m/s)
January	5.01	0.53	4.83
February	5.43	0.54	5.05
March	6.05	0.58	4.76
April	6.40	0.62	3.58
May	5.73	0.56	3.08
June	5.00	0.50	4.18
July	5.32	0.51	4.69
August	5.50	0.54	5.30
September	5.84	0.57	4.32
October	5.71	0.57	4.34
November	5.38	0.56	3.95
December	5.01	0.54	4.42

The monthly load profile of electricity demand for Miangas island community for one year that used in HOMER simulation is presented in Fig. 1.

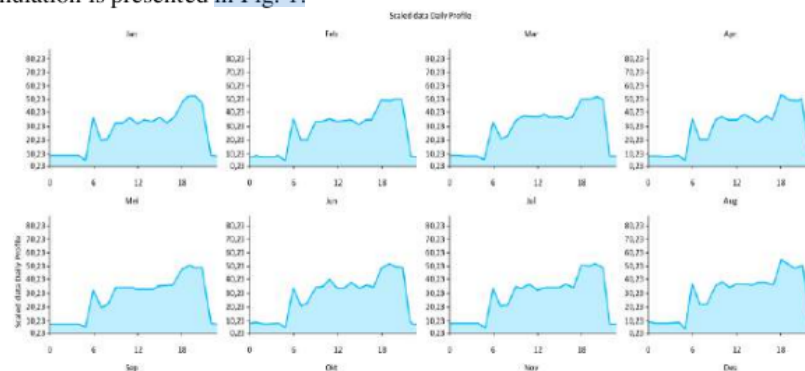


Fig. 1. The monthly load profile for island communities in Miangas Island.

The simulation of the system was done by HOMER (Hybrid Optimization Model for Electric Renewable) software that developed by National Renewable Energy Laboratory, USA. HOMER software is used for designing of Distributed Generator (DG) systems either off grid or on grid. Its algorithms permit to assess the technical and economic feasibilities of a big system that has lots of technical options and variations. Optimization and the sensitivity analysis are two of its great features. The input of HOMER for modelling the system configuration is consist of load profile, component specifications including size and numbers, resources data, economics, system control, emissions, constraints etc. HOMER provides a method for finding the least-cost system model based on load profile, system components and energy sources data.

The proposed hybrid system of power supply of electrical energy to serve Miangas island consists of PV, wind turbine, diesel generator, battery and converter are shown in Fig. 2.

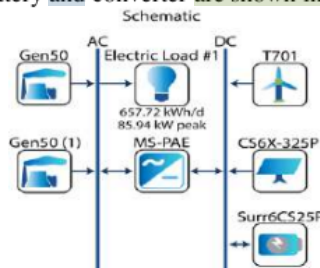


Fig. 2. The proposed of hybrid power generation model for Miangas Island.

There are two buses in the system; AC and DC bus. The output energy of solar PV is stored in a battery which is on the DC bus side. To convert AC from DC, a converter MS-PAE is used. The design for solar power systems uses Canadian solar Max Power C56x-325P 200 KW of PV, Pika T701 1.5 KW of wind turbine, Diesel Generator 2x50 kW and battery Surrrette 6CS25P. The detail description of the components of the hybrid system as the input for analysis are presented in Table 3.

Table 3. The components of the hybrid system analysis

Characteristics	PV Module	Wind Turbine	Diesel Generator	Battery	Converter
Model	Solamax Power	Pika T701	Generic Fixed	Sur6CS25P	Magnum
Power	200 kW	1.5 kW	50 kW	820 AH; 16 V	200 kW
Life time	25 years	20 years	15 years	20 years	10 years
Capital Cost	25,000 USD	5995 USD	25,000 USD	1000 USD	2255 USD
Replacement	20,000 USD	5995 USD	25,000 USD	500 USD	2255 USD
Maintenance	0	100 USD	1500 USD	0	0

4. Results

The study performs the optimization through HOMER software. It performs the energy model for each system configurations feasible and estimates cost of installing and operating the system over the life time of the project. HOMER simulates all of the possible system configurations that meet the electricity demand for Miangas island by considering the renewable energy resources such as solar and wind energy potential. The capacity and cost of the proposed hybrid system based on PV-Wind –Diesel-Battery model components are presented in Table 4.

Table 4. The capacity and cost of the proposed hybrid system components

Item	Value
Capacity of PV	200 kW
Capacity of Diesel	2 x 50 kW
Battery	80 string
Capacity of Converter	25 kW
Energy cost per kWh (COE)	0.3178 USD
Net Present Cost (NPC)	986.356 USD
Operating Cost	52.887 USD

HOMER determines the value of the appropriate component capacity so as to produce a good and reliable power system in serving the load in terms of capacity of power plant component, yearly electric energy production, initial capital cost, total Net Present Cost (NPC), energy cost per kWh (COE). The simulation results show that the hybrid (wind-PV-diesel battery) system has net present cost (NPC) 986356 USD with Cost of energy (COE) 0.3178 USD/ kWh.

The annual electricity production from the hybrid system design proposed is 431,114 kWh in which 77% electricity comes from PV, 22.5% electricity comes from diesel and 0.5% electricity comes from wind turbine. This proposed hybrid power system can produce as 166,329.018 kWh per year of excess electricity for Miangas island. The monthly average electricity production is shown in Figure 3.

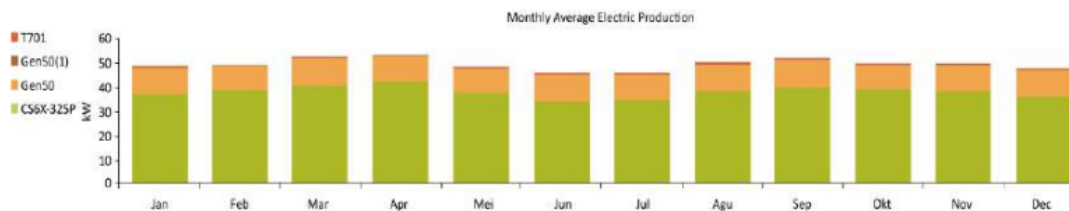


Fig. 3. The monthly average production based on the proposed hybrid power system in Miangas Island.

The Fig. 3 shows the significant part of varying electricity production from renewable energy that can be performed for Miangas island. The result shows that the prospect of renewable energy from solar energy and wind energy in Miangas island could be an alternative supply to generate electricity for remote community island.

In order to show the consequences of changing diesel price in the island, a sensitivity analysis has been conducted. Table 5 presents the sensitivity analysis for diesel prices ranging e.g 1 US\$/L, 2 US\$/L and 3 US\$/L case.

Table 5. Sensitivity analysis result for diesel price

Diesel [US\$/L]	Fuel [US\$]	Cost of Energy [US\$]	Net Present Cost [US\$]	Operating Cost [US\$]	Initial Cost [US\$]
1	0.317	0.317	986,356	52,887	296,660
2	0.463	0.463	1,440,000	87,018	311,660
3	0.608	0.608	1,890,000	119,609	340,121

The sensitivity analysis performs that the increasing of diesel prices could effect to the increasing of cost of energy (COE), net present cost (NPC), operating cost as well as initial cost significantly.

5. Conclusion

Based on the simulation result using HOMER software, the model of power plant system based on hybrid energy that consist of PV-Wind-Diesel and Battery for island community's electric energy demand in Miangas island can be obtained. Additionally the Cost of Energy (COE), Net Present Cost (NPC) and operating cost for proposed hybrid PV-Diesel power generation can be assessed.

This study can be an initial analysis for further analysis in implementing the infrastructure of power system based on renewable energy resources for island communities. The proposed PV-wind-diesel Hybrid power electricity generation become an alternative way for the remote island to meet electricity demand for the sake of security, welfare and beauty as an added value in Indonesia's border region.

Acknowledgments

This research has been funded by Directorate General of Research and Development, Ministry of Research, Technology and Higher Education of The Republic of Indonesia through INSINAS scheme.

References

- [1] Rumbayan M, Nagasaka K. Techno economical study of PV-Diesel power system for a remote island in Indonesia : A case study of Miangas Island, In: *Proc. of IOP Conference Series: Earth and Environmental Science*, 201; 8150.
- [2] Mamaghani AH, Escandon SAA, Najafi B, Shirazi A, Rinaldi F. Techno-economic feasibility of photovoltaic, wind, diesel and hybrid electrification systems for off-grid rural electrification in Colombia. *Renewable Energy*, 2016; 97: 293-305.
- [3] Dursun B, Gokcol C, Umut I, Ucar E, Kocabey S. Techno-economic evaluation of a hybrid PV-wind power generation system. *International Journal of Green Energy*, 2013; 10: 117-136.
- [4] Bekele G and Palm B. Feasibility study for a standalone solar-wind-based hybrid energy system for application in Ethiopia. *Applied Energy*, 2010; 87: 487-495.
- [5] Lipu MSH, Uddin S, Miah MAR. A feasibility study of solar-wind-diesel hybrid system in rural and remote areas of Bangladesh. *International Journal of Renewable Energy Research*, 2103: 3(4).
- [6] Al-Badi AH. Hybrid (solar and wind) energy system for Al Hallaniyat Island electrification. *International Journal of Sustainable Energy*, 2011; 30 (4): 212-222.
- [7] Himri Y, Stambouli AB, Draoul B, Himri S. Techno economical study of hybrid power system for a remote village in Algeria. *Energy*, 2008; 33 (7): 1128-1136.
- [8] Nandi S, Gosh HR. Prospect of wind-PV-battery hybrid system as an alternative to grid extension in Bangladesh. *Energy*, 2010; 35 (7): 3040-3047.
- [9] Nfah EM, Ngundam JM, Vandenberg M, Schmid J. Simulation of off-grid generation options for remote villages in Cameroon. *Renewable Energy*, 2008; 33 (5):1064-1072.
- [10] Brandon H. Newell. The evaluation of Homer As a marine corps expeditionary energy pre-deployment tool. Thesis. Master Of Science in Electrical Engineering. Naval Postgraduate School, 2010.
- [11] Naves D, Silva C, Connors S. Design and implementation of hybrid renewable energy systems on micro-communities: A review on case studies. *Renewable and Sustainable Energy Reviews*, 2014; 3:1 935-936.
- [12] Khare S, Nema P, Baredar P. Solar-wind hybrid renewable energy system: A review. *Renewable and Sustainable Energy Reviews*, 2016; 58: 23-33.
- [13] Mamaghani AH, Escandon SAA, Najafi B, Shirazi A, Rinaldi F. Techno-economic feasibility of photovoltaic, wind, diesel and hybrid electrification systems for off-grid rural electrification in Colombia. *Renewable Energy*, 2016; 97: 293-305.
- [14] Ding JJ, Buckeridge JS. Design considerations for a sustainable hybrid renewable energy system. *IPENZ Transactions*, 2000; 27(1): 1-5.
- [15] G. Rohani and M. Nour. Techno-economical analysis of stand alone hybrid renewable power system for Ras Musherib in United Arab Emirates. *Energy*, 2014; 64: 828-841.
- [16] Chmiel Z, Bhattacharya SC. Analysis of off-grid electricity system at Isle of Eigg (Scotland): Lessons for developing countries. *Renewable Energy*, 2015; 81: 578-588.
- [17] Rumbayan M, Abudureyimu A, and Nagasaka K. Mapping of solar energy potential in Indonesia using artificial neural network and geographical information system. *Renewable and Sustainable Energy Reviews*, 2012; 16(3): 1437-1449.

Prospect of PV-wind-diesel hybrid system as an alternative power supply for Miangas Island in Indonesia

ORIGINALITY REPORT

19%

SIMILARITY INDEX

9%

INTERNET SOURCES

15%

PUBLICATIONS

8%

STUDENT PAPERS

PRIMARY SOURCES

- 1 Othmane Echarradi, Abdessamad Benlafkih, Abdelkader Hadjoudja, Mounir Fahoume. "Ecological impact due to the implementation of a modeled and optimized hybrid system", International Journal of Electrical and Computer Engineering (IJECE), 2023
Publication 1%
- 2 publications.waset.org
Internet Source 1%
- 3 Submitted to City University
Student Paper 1%
- 4 Nadjemi, O., T. Nacer, A. Hamidat, and H. Salhi. "Optimal hybrid PV/wind energy system sizing: Application of cuckoo search algorithm for Algerian dairy farms", Renewable and Sustainable Energy Reviews, 2016.
Publication 1%
- 5 squ.pure.elsevier.com
Internet Source 1%

6	Submitted to Engineers Australia Student Paper	1 %
7	Submitted to University of the Sunshine Coast Student Paper	1 %
8	www.hindawi.com Internet Source	1 %
9	P. Balamurugan, S. Kumaravel. "The Development Of A Generalized Optimal Operating Strategy For A Hybrid Energy System", International Journal of Green Energy, 2013 Publication	1 %
10	Shaahid, S.M.. "Review of research on autonomous wind farms and solar parks and their feasibility for commercial loads in hot regions", Renewable and Sustainable Energy Reviews, 201110 Publication	1 %
11	Submitted to Universitat Politècnica de València Student Paper	1 %
12	academic.hep.com.cn Internet Source	1 %
13	www.eea-journal.ro Internet Source	1 %
14	Submitted to Higher Education Commission Pakistan	1 %

15 Submitted to International Islamic University Malaysia 1 %
Student Paper

16 Monaaf D.A. Al-falahi, S.D.G. Jayasinghe, H. Enshaei. "A review on recent size optimization methodologies for standalone solar and wind hybrid renewable energy system", Energy Conversion and Management, 2017 <1 %
Publication

17 Submitted to Technical University Delft <1 %
Student Paper

18 researcharchive.vuw.ac.nz <1 %
Internet Source

19 smujo.id <1 %
Internet Source

20 Submitted to IIT Delhi <1 %
Student Paper

21 www.currentscience.ac.in <1 %
Internet Source

22 C. Koroneos, G. Xydis, A. Polyzakis. "The Optimal use of Renewable Energy Sources—The Case of Lemnos Island", International Journal of Green Energy, 2013 <1 %
Publication

23 Submitted to Universiti Teknologi Malaysia <1 %
Student Paper

24	microgridnews.com Internet Source	<1 %
25	pubs.aip.org Internet Source	<1 %
26	Theofilos Mastos, Katerina Gotzamani, Dimitrios Kafetzopoulos. "Development and Validation of a Measurement Instrument for Sustainability in Food Supply Chains", <i>Sustainability</i> , 2022 Publication	<1 %
27	dokumen.pub Internet Source	<1 %
28	ijece.iaescore.com Internet Source	<1 %
29	ijireeice.com Internet Source	<1 %
30	www.ajol.info Internet Source	<1 %
31	Centeno Brito, Miguel, Killian Lobato, Pedro Nunes, and Filipe Serra. "Sustainable energy systems in an imaginary island", <i>Renewable and Sustainable Energy Reviews</i> , 2014. Publication	<1 %
32	Cheng-Shan Wang, Bo Yu, Jun Xiao, Li Guo. "Multi-scenario, multi-objective optimization of grid-parallel Microgrid", 2011 4th International Conference on Electric Utility	<1 %

Deregulation and Restructuring and Power Technologies (DRPT), 2011

Publication

33

Submitted to University of Glamorgan

Student Paper

<1 %

34

Xueqian Fu, Yazhong Zhou. "Collaborative Optimization of PV Greenhouses and Clean Energy Systems in Rural Areas", IEEE Transactions on Sustainable Energy, 2023

Publication

<1 %

35

faratarjome.ir

Internet Source

<1 %

36

www.politesi.polimi.it

Internet Source

<1 %

37

Abraham Kebede, Maitane Berecibar, Thierry Coosemans, Maarten Messagie, Towfik Jemal, Henok Behabtu, Joeri Van Mierlo. "A Techno-Economic Optimization and Performance Assessment of a 10 kWp Photovoltaic Grid-Connected System", Sustainability, 2020

Publication

<1 %

38

Asadullah Shaikh, Pervez Hameed Shaikh, Laveet Kumar, Nayyar Husain Mirjat et al. "Design and Modeling of A Grid-Connected PV-WT Hybrid Microgrid System Using Net Metering Facility", Iranian Journal of Science and Technology, Transactions of Electrical Engineering, 2022

Publication

<1 %

39

S. M. Shaahid, I. El-Amin, S. Rehman, A. Al-Shehri, F. Ahmad, J. Bakashwain, Luai M. Al-Hadhami. "Techno-Economic Potential of Retrofitting Diesel Power Systems with Hybrid Wind-Photovoltaic-Diesel Systems for Off-Grid Electrification of Remote Villages of Saudi Arabia", International Journal of Green Energy, 2010

Publication

<1 %

40

Yavuz Bahadır Koca, Yüksel Oğuz, Ahmet Yönetken. "Investigation Efficiency and Microcontroller-Based Energy Flow Control for Wind-Solar-Fuel Cell Hybrid Energy Generation System with Battery Storage", Measurement and Control, 2017

Publication

<1 %

41

Aasim Ullah, S.M.Shahnewaz Siddiquee, MD.Emran Hossain. "Optimization of hybrid renewable energy system for a base transceiver station (BTS) in Bangladesh", 2014 3rd International Conference on the Developments in Renewable Energy Technology (ICDRET), 2014

Publication

<1 %

42

Bekele, G.. "Feasibility study for a standalone solar-wind-based hybrid energy system for application in Ethiopia", Applied Energy, 201002

Publication

<1 %

43 Binayak Bhandari, Kyung-Tae Lee, Gil-Yong Lee, Young-Man Cho, Sung-Hoon Ahn. "Optimization of hybrid renewable energy power systems: A review", International Journal of Precision Engineering and Manufacturing-Green Technology, 2015
Publication

44 Mandelli, Stefano, Jacopo Barbieri, Riccardo Mereu, and Emanuela Colombo. "Off-grid systems for rural electrification in developing countries: Definitions, classification and a comprehensive literature review", Renewable and Sustainable Energy Reviews, 2016.
Publication

45 Marcel Kwaye Pendieu, Norma Anglani. "Hybrid energy systems for remote areas and the role of storage", 2015 IEEE International Conference on Industrial Technology (ICIT), 2015
Publication

46 Ngan, M.S.. "Assessment of economic viability for PV/wind/diesel hybrid energy system in southern Peninsular Malaysia", Renewable and Sustainable Energy Reviews, 201201
Publication

Exclude quotes On

Exclude matches Off

Exclude bibliography On